

1922

COMPTROLLER'S COPY.

NORTHERN PACIFIC RAILWAY COMPANY

AUTHORITY FOR EXPENDITURE

1922 1922

Superintendent's No. 1361
No.

Dept. No. 12
Engineering Dept. No. 007

A. F. No. 101

Yellowstone Div. Second District State No. DAK. Val. Ser. No.

AUTHORITY IS REQUESTED FOR A NET EXPENDITURE OF \$ 12907.00

Accounting distribution as follows: (Distribution to be made in General Office.)

	Operating Expenses	Profit and Loss	Net Operating Expenses	Net Profit and Loss
Cost of property retired	1988			
Value of salvage	74		1914	
Incidental costs			275	
Total to Operating Expenses				\$2189
Total to Profit and Loss				74
To Material and Supplies				
To Bills for Collection				
To Other Accounts				
Net charge to investment account—Additions and Betterments				10718
Total of distribution				\$12981

REPRODUCTION DOCUMENT 1...0 ENTERED ON EXHIBIT 6

Budget reference: *In Budget* Class of Work: No. 20 ✓

Joint facility contract reference: **Not Joint Account**

The location is ----- on this company's property. To secure rights, it will be necessary to do nothing.

Location: **Belfield.**

Title **Estimated cost proposed new 100,000 gallon water tank and stand and pipe, as per sketch dated October 25th, 1921.**
Reason:

48,000 gallon water tank at Belfield was built in 1898. Both the tub and the under frame are very badly decayed. Seven years ago the tub was taken apart and a new chime cut in the staves in order to extend its life. its condition is now such that further repairs are impossible, and standing as it does next to the main line, it is a menace. If it is not to be replaced, a new under frame must be built and this expense is not warranted considering the condition of the tub. Belfield is a very important water station, being the only one between Dickinson and Medora, a distance of 39.6 miles, and failure of the tank would very seriously interfere with our operation.

It is recommended that a 100,000 gallon tank and standpipe be built in accordance with attached estimate and blue print.

Original Cost Adjustment
Made in 1923 19...

Checked and Entered
President's Office

Stamp: M. J. ...

Work to be done by ~~company force~~ **company force** under charge of **Division Superintendent.**

Accounting to concentrate in the office of **Superintendent Glendive Mont.**


Signature and Title: *[Signature]* Supt. Date **Nov. 19th, 19 21.**

<i>[Signature]</i> General Superintendent.	<i>[Signature]</i> Asst. Engr. Maint. of Way.	<i>[Signature]</i> Assistant General Manager.
<i>[Signature]</i> Mech. Supt., Supt. Telg. or Signal Engr.	<i>[Signature]</i> Chief Engineer.	<i>[Signature]</i> General Manager.
<i>[Signature]</i> General Auditor or Comptroller.	<i>[Signature]</i> President.	<i>[Signature]</i> Vice President.

Date of Final Approval } FEB 6 - 1921 19

COMPTROLLER'S RECORD OF NOTICE OF APPROVAL AND OF COMPLETION

Form No. 1345 issued **FEB 10 1922** Work begun 19 Work finished **Sept 5 19 22**

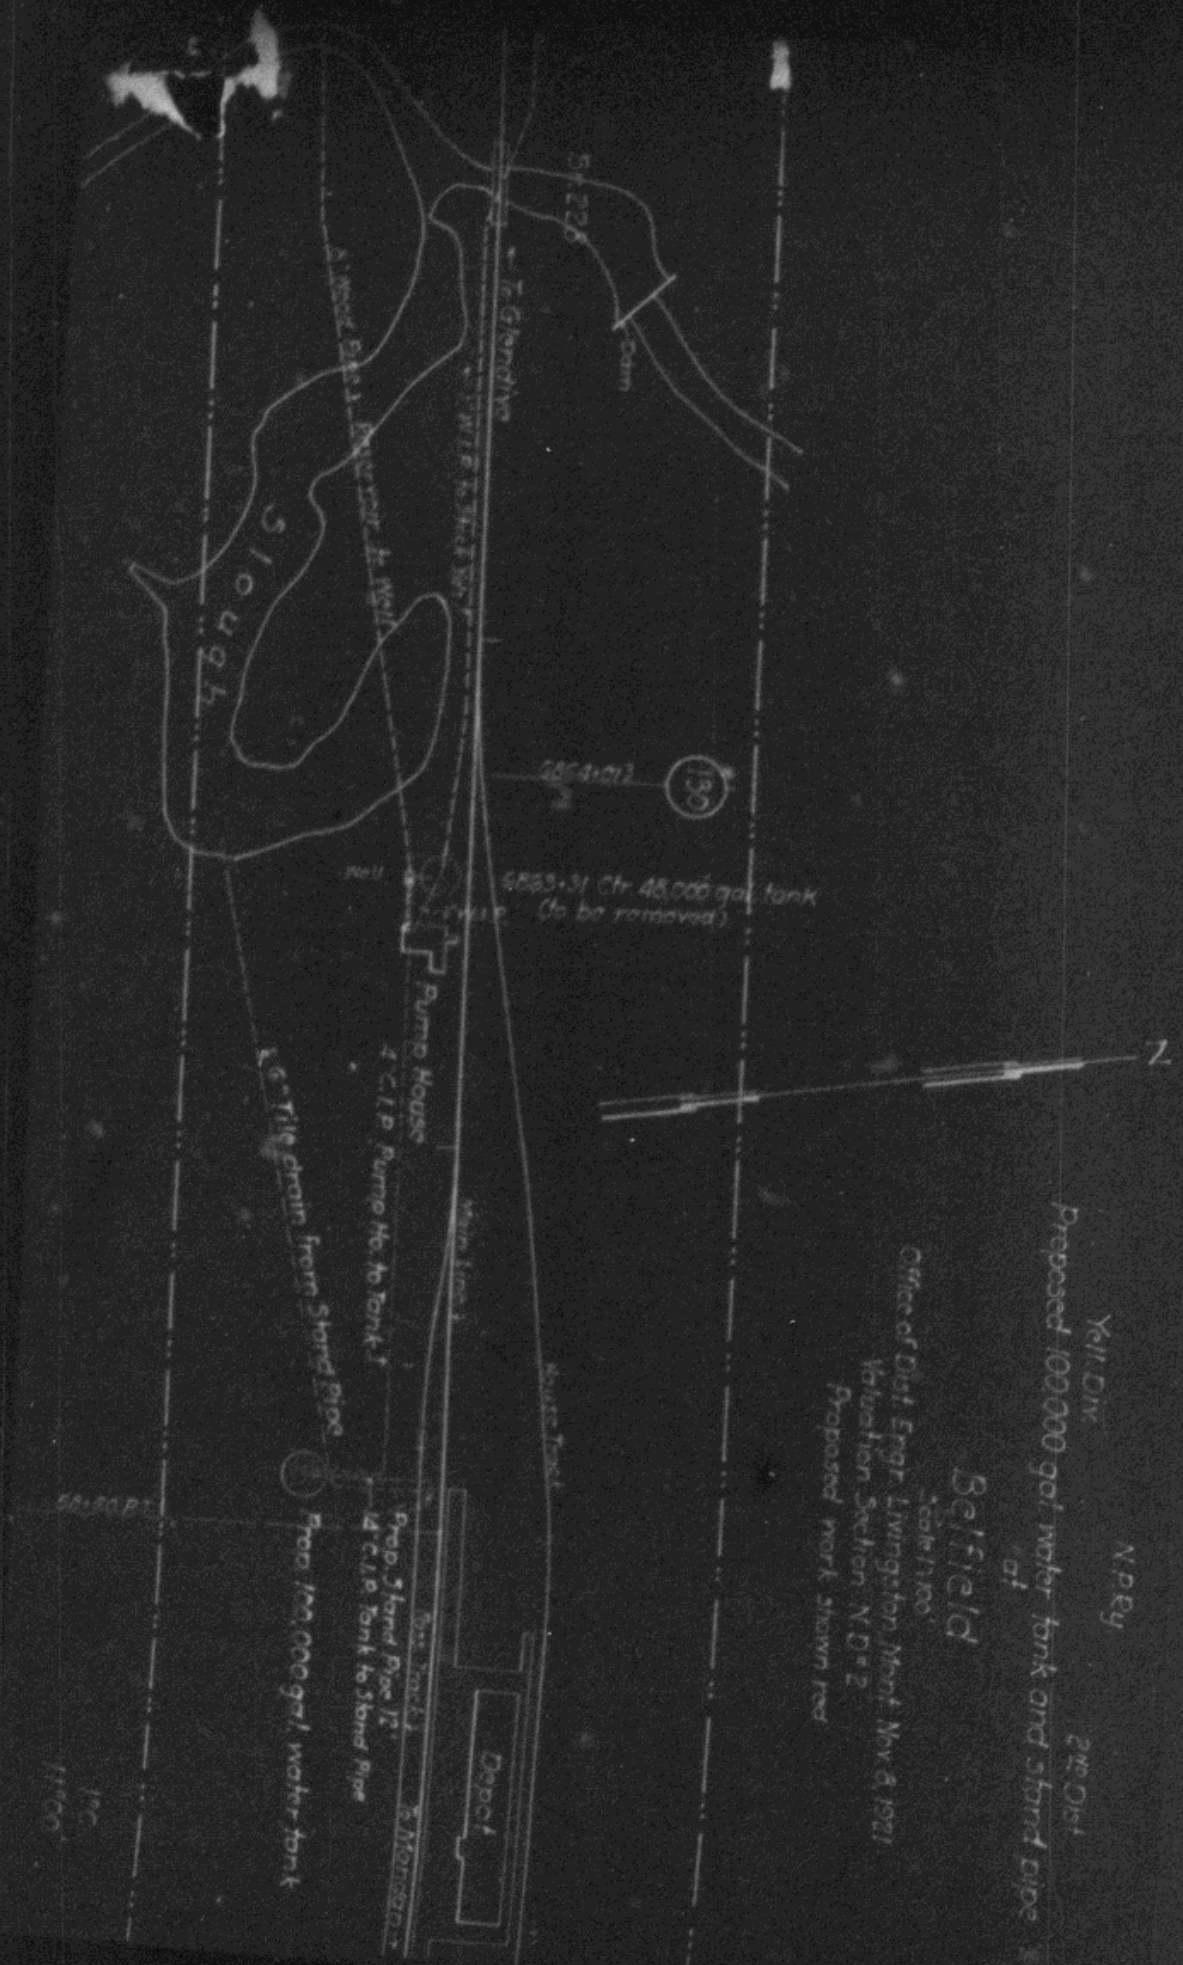

N.P.E.G. 2nd Dist.
 Yell Div. Proposed 100,000 gal. water tank and slough pipe
 at
Bethfield
 Office of Dist. Engr. Livingston Mont. Nov 8, 1921
 Valuation Section N.D.# 2
 Proposed work shown red