

NORTHERN PACIFIC RAILWAY COMPANY

COMPTROLLER'S COPY

1926
SUPERINTENDENT'S NO.
JTD No. 47

AUTHORITY FOR EXPENDITURE

1926 DEPT. No.
ENGINEERING DEPT. No. 101

1926
A. F. E. No. 123

St Paul

Div.

Mpls Terminal

DISTRICT
BRANCH

STATE Minn.

VAL. SEC. No. 9

AUTHORITY IS REQUESTED FOR A NET EXPENDITURE OF \$ 3891

Accounting distribution as follows: (Distribution to be made in General Office.)

Cost of property retired \$ Operating Expenses \$ Profit and Loss \$ Net Operating Expenses \$ Net Profit and Loss \$
Value of salvage \$
Incidental costs \$

Total to Operating Expenses

Total to Profit and Loss

To Material and Supplies

To Bills for Collection

To Other Accounts

Net charges to investment account—Additions and Betterments

Total of distribution

Original Cost Adjustment
Made in MAY 18 1927 19

Original Cost Adjustment
Made in APR 27 1927 19

595

3398

3891

Budget reference: Not in budget

Joint facility contract reference: Not Joint Account

Class of Work: No. 21 23

The location is --- on this company's property. To secure rights, it will be necessary Nothing
Location: Northtown, Minn

Title: One 150 HP Return Tubular Boiler - Northtown Power Plant

Reason: The steam load during the winter months at Northtown has increased during the last few years. Additional heating is now required for yard office, new car shop, car foreman's office, switchmen's office, as well as the round-house and store buildings. This increased load over-taxes the three existing boilers, which cannot take care of the requirements during the severe winter weather. This condition necessitates cutting in a locomotive on the flower lines in the round-house from six to eight days per month during the winter period. Furthermore, it is necessary to cut out a boiler once each month for washing, in which case it is necessary to provide a locomotive to take care of the steam requirements.

It is proposed to move 150 HP boiler available at Kootenai to Northtown and authority is requested for this expenditure.

Work to be done by company force under charge of Superintendent

Accounting to concentrate in the office of Superintendent

Engineer and Title:

APPROVED: *[Signature]* DISTRICT ENGINEER, Superintendent Date Dec 6, 1925
General Superintendent, *[Signature]* Engineer, Maint. of Wry, General Manager
Chief Engineer, *[Signature]* Vice President
For Comptroller, *[Signature]* President
Date of Final Approval: JAN 20 1926


COMPTROLLER'S RECORD OF NOTICE OF APPROVAL AND OF COMPLETION

No. 1345 issued

Work begun

Work finished

00

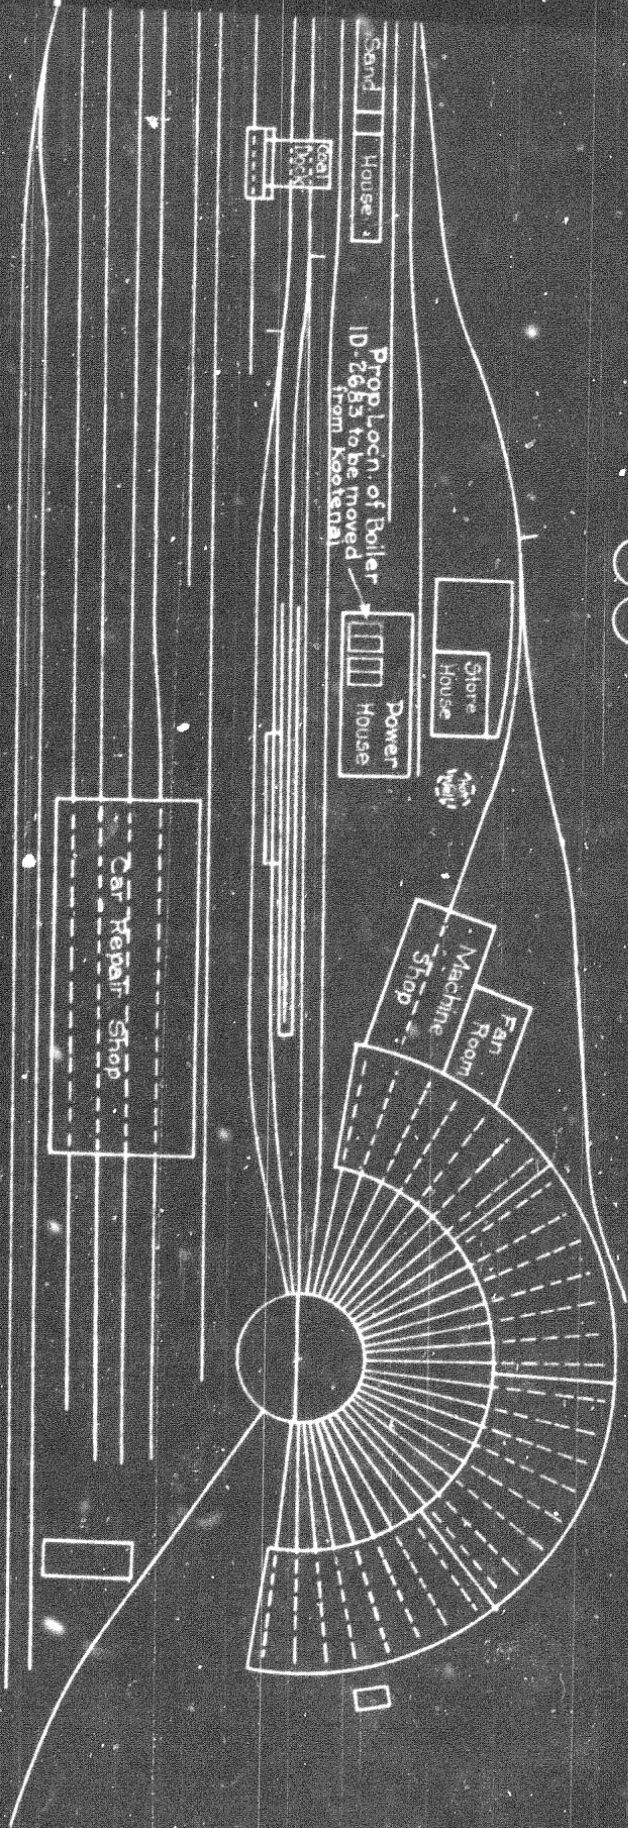

N.P.R.Y.

St. Paul Division

Main Line

Prop. Installation of Boiler, ID-No. 2683

NORTHTOWN

Scale 1"=100'

Office of District Engineer St. Paul, Dec. 3, 1925

Prop. work shown Red
Val. Sec. 9-Mmm